


SANITRON® INSTALLATION



Typical mounting arrangement
Showing wire connections on bottom of box

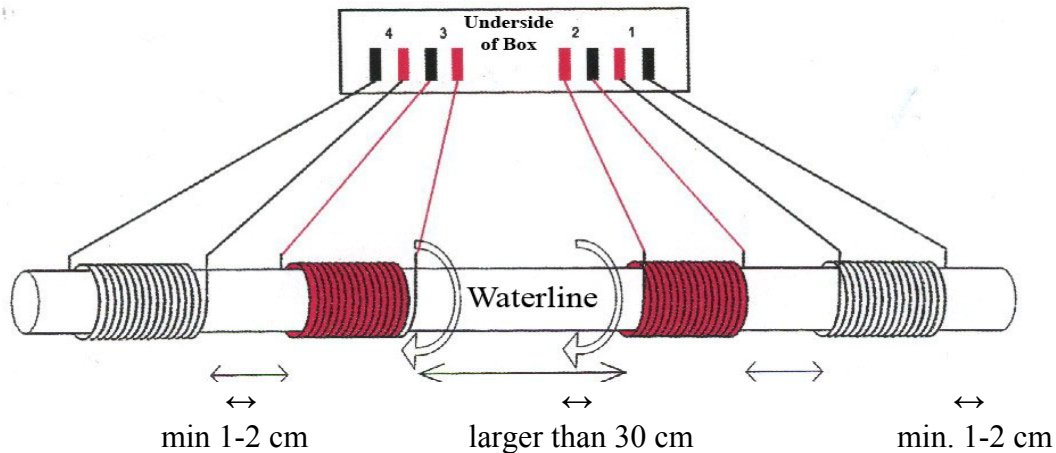

A min. of 20 windings are needed per coil requiring approx. 60 cm of space each.

A four-fold induction effect will be achieved through coil windings mounted on main water supply.

The exterior installation of induction coils causes no interruption to the flow of water.

Installation should be near water meter and can be on horizontal or vertical pipe runs even elbows. Check with your supplier about other installation configurations.

When installing in addition to an existing water softening unit, the SANITRON unit must be placed **after** the existing water softener.

You must follow the instructions with respect to the direction in which to apply the coil wire!